

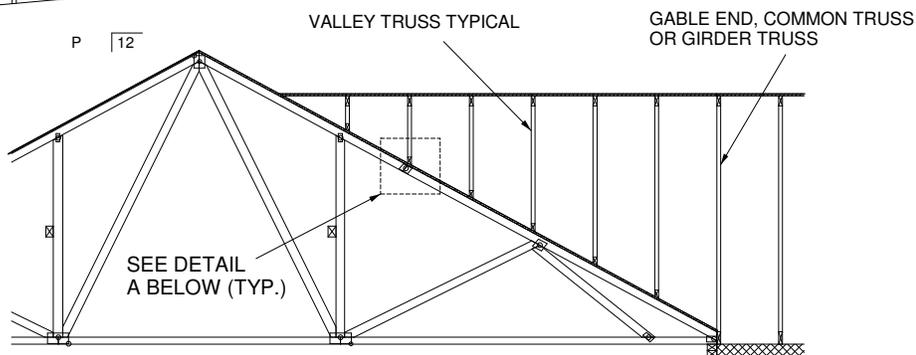


GENERAL SPECIFICATIONS

1. NAIL SIZE 10d (0.131" X 3")
2. WOOD SCREW = 4.5" WS45 USP OR EQUIVANT
3. INSTALL SHEATHING TO TOP CHORD OF BASE TRUSSES.
4. INSTALL VALLEY TRUSSES (24" O.C. MAXIMUM) AND SECURE TO BASE TRUSSES AS PER DETAIL A
5. BRACE VALLEY WEBS IN ACCORDANCE WITH THE INDIVIDUAL DESIGN DRAWINGS.
6. NAILING DONE PER NDS-01
7. VALLEY STUD SPACING NOT TO EXCEED 48" O.C.

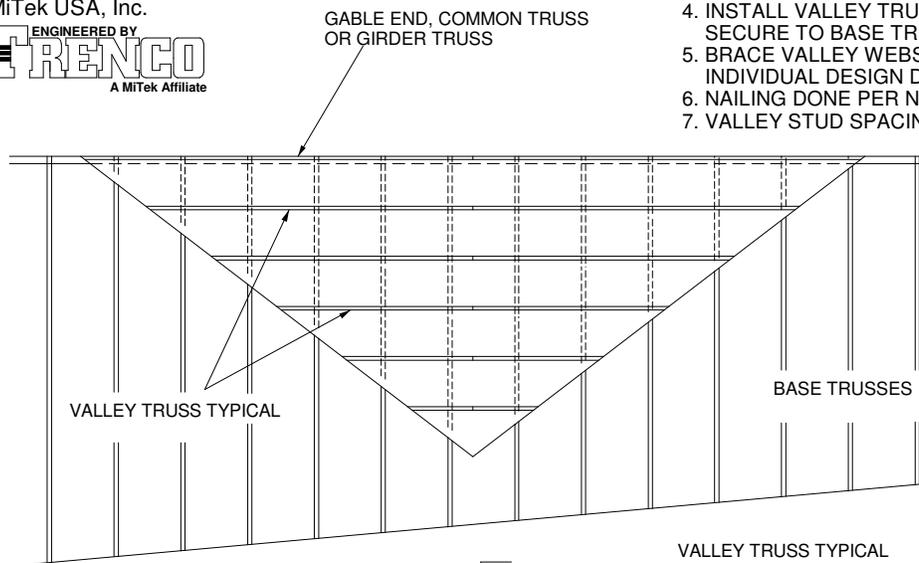

SECURE VALLEY TRUSS  
W/ ONE ROW OF 10d  
NAILS 6" O.C.

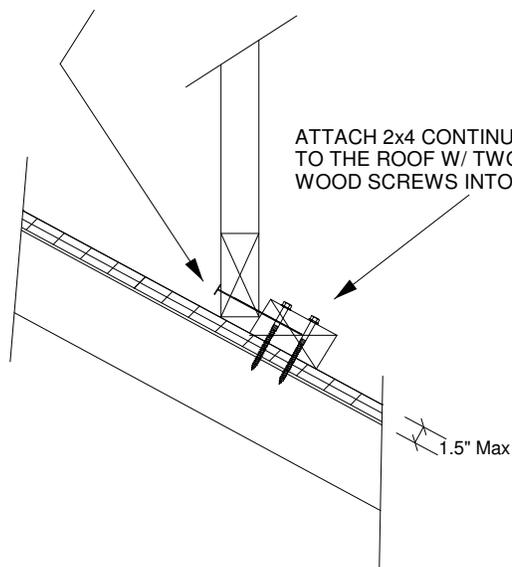

ATTACH 2x4 CONTINUOUS NO.2 SPF  
TO THE ROOF W/ TWO USP WS45 (1/4" X 4.5")  
WOOD SCREWS INTO EACH BASE TRUSS.

WIND DESIGN PER ASCE 7-98, ASCE 7-02, ASCE 7-05 146 MPH  
WIND DESIGN PER ASCE 7-10, ASCE 7-16 160 MPH  
MAX MEAN ROOF HEIGHT = 30 FEET  
ROOF PITCH = MINIMUM 3/12 MAXIMUM 6/12  
CATEGORY II BUILDING  
EXPOSURE C  
WIND DURATION OF LOAD INCREASE : 1.33  
MAX TOP CHORD TOTAL LOAD = 50 PSF  
MAX SPACING = 24" O.C. (BASE AND VALLEY)  
MINIMUM REDUCED DEAD LOAD OF 6 PSF  
ON THE TRUSSES